

LABORATORY SAFETY SIGN / NFPA DIAMOND CREATOR

CLICK HYPERLINK ON THE TYPE OF SIGN (BELOW) THAT YOU WANT TO CREATE

CALIFORNIA INSTITUTE OF TECHNOLOGY
Laboratory Safety Sign

Building Name: _____ Room/Lab Number: _____

IN THE EVENT OF AN EMERGENCY, CONTACT CALTECH SECURITY x5000 or (626) 895-5000

Emergency Contact Name: _____ Day Phone: _____ Night Phone: _____

1. _____
2. _____
3. _____
4. _____

Required Personal Protective Equipment


Lab Coat Appropriate Gloves Other: _____
 Safety Glasses Face Shield _____
 Closed-toe Shoes Face Mask/Respirator _____

HAZARDS PRESENT

Flammable Gases Biohazards (infectious, recombinant DNA)
 Flammable Liquids Aerosols
 Noxious Gases or Vapors Projects under pressure or vacuum
 Corrosive Liquids (Acids or Bases) Continuously heated or cooled projects
 Water Reactive Materials Neurotoxins
 High voltage
 Radioactive Materials
 Computers
 Other (list below): _____
Lasers

List Specifics: _____

Updated: _____



WARNING - THIS AREA CONTAINS A CHEMICAL KNOWN TO THE STATE OF CALIFORNIA TO CAUSE CANCER OR BIRTH DEFECTS OR OTHER REPRODUCTIVE HARM.

**CHEMICALS
ONLY**

CAUTION

Building Name: _____ Room/Lab Number: _____

IN THE EVENT OF AN EMERGENCY, CONTACT CALTECH SECURITY x5000 or (626) 895-5000

Emergency Contact Name: _____ Day Phone: _____ Night Phone: _____

1. _____
2. _____

Required Personal Protective Equipment


Lab Coat Appropriate Gloves Other: _____
 Safety Glasses Face Shield _____
 Closed-toe Shoes Face Mask/Respirator _____

HAZARDS PRESENT

Flammable Gases Biohazards (infectious, recombinant DNA)
 Flammable Liquids Aerosols
 Noxious Gases or Vapors Projects under pressure or vacuum
 Corrosive Liquids (Acids or Bases) Continuously heated or cooled projects
 Water Reactive Materials Neurotoxins
 High voltage
 Radioactive Materials
 Computers
 Other (list below): _____
Lasers

List Specifics: _____

Updated: _____



WARNING - THIS AREA CONTAINS A CHEMICAL KNOWN TO THE STATE OF CALIFORNIA TO CAUSE CANCER OR BIRTH DEFECTS OR OTHER REPRODUCTIVE HARM.

**CHEMICALS
W/ RATING = 4**

CAUTION

Building Name: _____ Room/Lab Number: _____

IN THE EVENT OF AN EMERGENCY, CONTACT CALTECH SECURITY x5000 or (626) 895-5000

Emergency Contact Name: _____ Day Phone: _____ Night Phone: _____

1. _____
2. _____

Required Personal Protective Equipment




Lab Coat Appropriate Gloves Other: _____
 Safety Glasses Face Shield _____
 Closed-toe Shoes Face Mask/Respirator _____

HAZARDS PRESENT

Flammable Gases Biohazards (infectious, recombinant DNA)
 Flammable Liquids Aerosols
 Noxious Gases or Vapors Projects under pressure or vacuum
 Corrosive Liquids (Acids or Bases) Continuously heated or cooled projects
 Water Reactive Materials Neurotoxins
 High voltage
 Radioactive Materials
 Computers
 Other (list below): _____
Lasers

List Specifics: _____

Updated: _____

WARNING - THIS AREA CONTAINS A CHEMICAL KNOWN TO THE STATE OF CALIFORNIA TO CAUSE CANCER OR BIRTH DEFECTS OR OTHER REPRODUCTIVE HARM.

**+ BIOHAZARDS
& RADIOACTIVE**

CAUTION

Building Name: _____ Room/Lab Number: _____

IN THE EVENT OF AN EMERGENCY, CONTACT CALTECH SECURITY x5000 or (626) 895-5000

Emergency Contact Name: _____ Day Phone: _____ Night Phone: _____

1. _____
2. _____

Required Personal Protective Equipment




Lab Coat Appropriate Gloves Other: _____
 Safety Glasses Face Shield _____
 Closed-toe Shoes Face Mask/Respirator _____

HAZARDS PRESENT

Flammable Gases Biohazards (infectious, recombinant DNA)
 Flammable Liquids Aerosols
 Noxious Gases or Vapors Projects under pressure or vacuum
 Corrosive Liquids (Acids or Bases) Continuously heated or cooled projects
 Water Reactive Materials Neurotoxins
 High voltage
 Radioactive Materials
 Computers
 Other (list below): _____
Lasers

List Specifics: _____

Updated: _____

WARNING - THIS AREA CONTAINS A CHEMICAL KNOWN TO THE STATE OF CALIFORNIA TO CAUSE CANCER OR BIRTH DEFECTS OR OTHER REPRODUCTIVE HARM.

+ BIOHAZARDS

CAUTION

Building Name: _____ Room/Lab Number: _____

IN THE EVENT OF AN EMERGENCY, CONTACT CALTECH SECURITY x5000 or (626) 895-5000

Emergency Contact Name: _____ Day Phone: _____ Night Phone: _____

1. _____
2. _____

Required Personal Protective Equipment



Lab Coat Appropriate Gloves Other: _____
 Safety Glasses Face Shield _____
 Closed-toe Shoes Face Mask/Respirator _____

HAZARDS PRESENT

Flammable Gases Biohazards (infectious, recombinant DNA)
 Flammable Liquids Aerosols
 Noxious Gases or Vapors Projects under pressure or vacuum
 Corrosive Liquids (Acids or Bases) Continuously heated or cooled projects
 Water Reactive Materials Neurotoxins
 High voltage
 Radioactive Materials
 Computers
 Other (list below): _____
Lasers

List Specifics: _____

Updated: _____

WARNING - THIS AREA CONTAINS A CHEMICAL KNOWN TO THE STATE OF CALIFORNIA TO CAUSE CANCER OR BIRTH DEFECTS OR OTHER REPRODUCTIVE HARM.


+ RADIOACTIVE

COMPLETING THE LABORATORY SAFETY SIGN

- Enter full building name and room/laboratory number on the sign.
- Enter the emergency contact information. The recommended emergency contacts for laboratories are the Principal Investigator and group Safety Coordinator.
- Mark the appropriate checks for personal protective equipment required in the area.
- Mark the appropriate checks for the hazards present in the laboratory. Note: when "other" is checked, indicate specifics in the "list specifics" column such as:
 - Water Reactive Material
 - Neurotoxins
 - Biohazards (Indicate Biohazard classification, i.e. Minimal Hazard)
 - Health, Flammability and/or Reactivity hazards rated 3 or above.
 - Enter the date the sign was updated on.

To find the classification rating for a chemical, refer to the Safety Data Sheet (SDS), chemical label, or contact the EH&S Office.

LABORATORY SAFETY SIGN / NFPA DIAMOND CREATOR

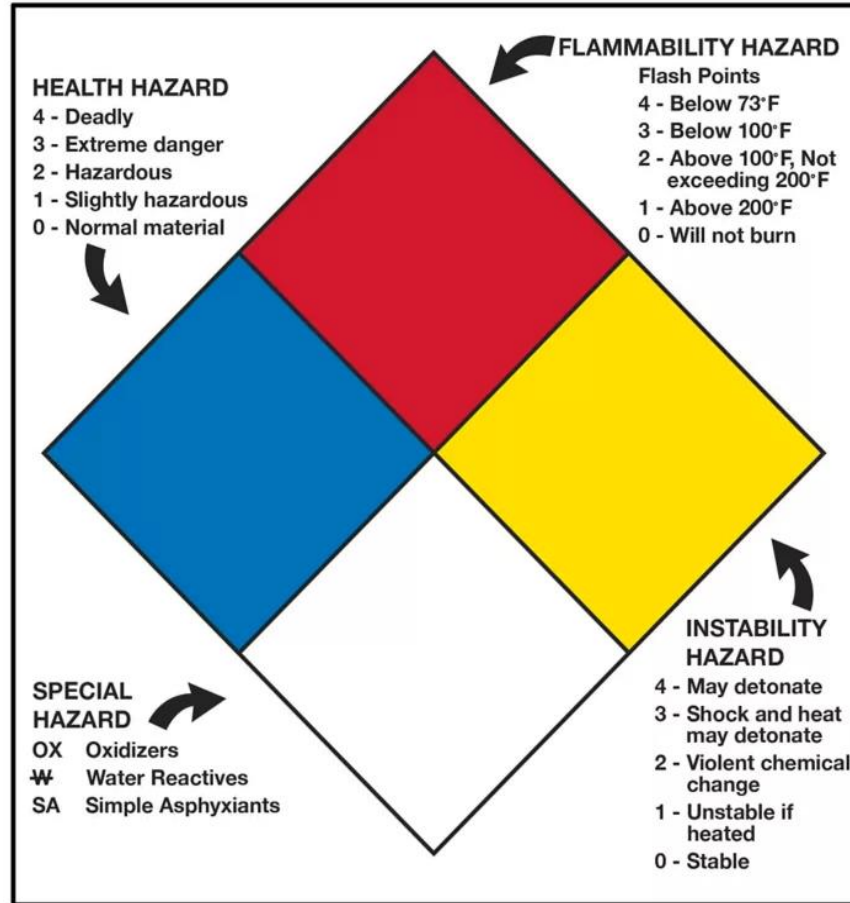

NOTE: Post the highest NFPA classification rating present in the area regardless of amount
For more information, see the [Laboratory and Workplace Safety Signs Program](#)